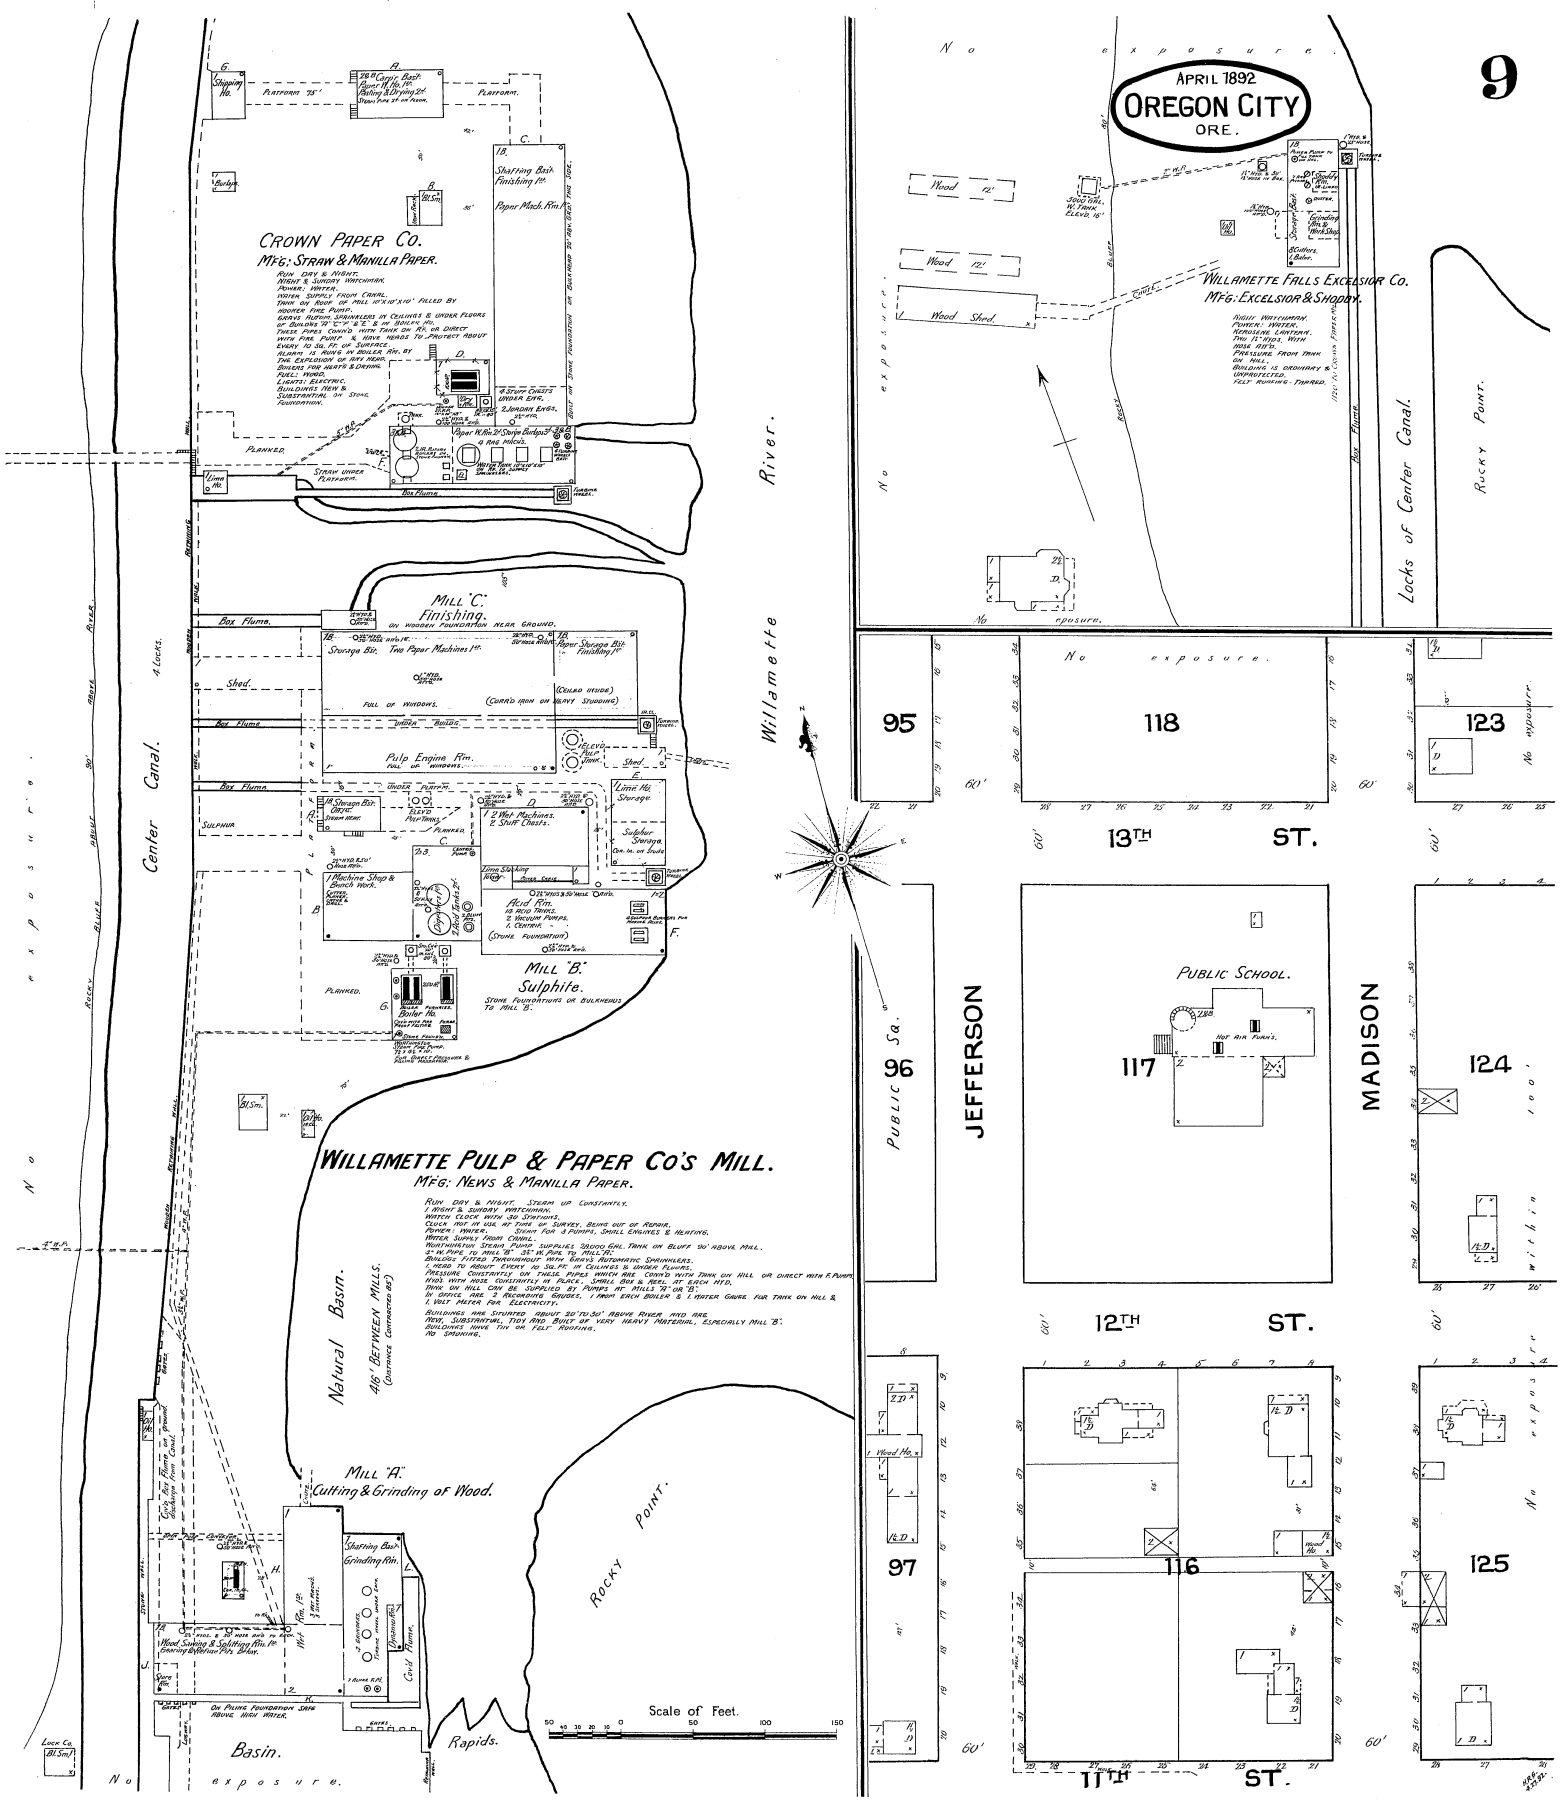
April 1892
Oregon City
Ore.
Crown Paper Co.
Mfg: Straw & Manilla Paper.
Run day & night.
Night & Sunday watchman.
Power: Water.
Water supply from canal.
Tank on roof of mill 17'x 18'x 10' filled by hooker fire pump.
Gravity flow, sprinklers in ceilings & under floors of building 79' 2" x 8' 2" & in boilers, etc.
These pipes conn'd with tank or R.R. or direct with fire pump & have hoses to protect about every 10 sq. ft. of surface.
Flume is above of boiler rm. by the explosion of dry mear.
Boilers for heats & drying.
Fuel: Wood.
Lights: Electric.
Buildings new & substantial on stone foundation.
Mill "C" Finishing.
Mill "B" Sulphite.
Stone foundations or bulkheads to mill "B".
Willamette Pulp & Paper Co's Mill.
Mfg: News & Manilla Paper.
Run day & night. Steam up constantly.
1 night & sunday watchman.
Water clock with 30 stations.
Clock not in use at time of survey, being out of repair.
Power: Water. Steam for 3 pumps, drill engines & heating.
Water supply from canal.
Worthington steam pump supplies 30000 gal. tank on bluff 90' above mill.
2" W. pipe to mill "B". 3" W. pipe to mill "A".
Buildings fitted throughout with Grey's automatic sprinklers.
1 head to about every 10 sq. ft. in ceilings & under floors.
Pressure constantly on these pipes which are conn'd with tank on hill or direct with F. pump.
H.D. with hose constantly in place. Small box & reel at each H.D.
Tank on hill can be supplied by pumps at mills "A" or "B".
In office are 2 recording gauges, 1 from each boiler & 1 water gauge for tank on hill & 1 volt meter for electricity.
Buildings are situated about 30' to 50' above river and are new, substantial, tidy and built of very heavy material, especially mill "B".
No smoking.
Mill "A" Cutting & Grinding of Wood.
Natural Basin.
416' between mills. (Distance contracted 85')
Rocky Point.
Rapids.
Basin.
Center Canal.
Willamette River.
Locks of Center Canal.
Rocky Point.
Willamette Falls Excelsior Co.
Mfg: Excelsior & Shoddy.
Night watchman.
Power: Water.
Kerosene lantern.
Two 12" H.D.'s with hose H.D.
Pressure from tank on hill.
Building is ordinary & unprotected.
Felt running - tarred.
No exposure.
Public School.
Hot Air Furns.
Jefferson
Madison
13th St.
12th St.
11th St.
Public Sq.
95
96
97
116
117
118
123
124
125
Scale of Feet.